



Programmable converter for thermocouple

DAT 2145

Via monte Nero, 40/B – 21049 TRADATE (VA) ITALY Phone: +39 (0)331841070 Fax: +39 (0)331841950 - e-r

Phone: +39 (0)331841070 Fax:+39 (0)331841950 - e-mail:datexel@datexel.it - www.datexel.it

FEATURES

- Input for thermocouples type K, J, R, S and T
- Unit of measure configurable in °C or °F
- Zero and Span values configurable by DIP-switches
- Voltage or current "voltage linear" output
- Good accuracy and performance stability
- EMC compliant CE mark
- DIN rail mounting in compliance with EN-50022 and EN-50035



 ϵ

GENERAL DESCRIPTION

The converter DAT 2145 is designed to provide on its output a voltage or current signal linear and proportional with the value of voltage generated from the thermocouple connected to its input.

The DAT 2145 doesn't execute the linearisation of the input signal; this feature allows to use the converter with acquisition systems with an internal linearisation software.

The user can program the input and output ranges by the proper DIP-switches available after opening the suitable door located on the side of device (see "Input range table" and "Output range table" sections).

The regulation of Zero and Span values is made by the ZERO and SPAN potentiometers located on the top of device.

It has been made in compliance with the EEC/336/89 standard on the Electromagnetic Compatibility.

It is housed in a plastic enclosure of 12.5 mm thickness suitable for DIN rail mounting in according to EN-50022 and EN-50035 standards.

OPERATIVE INSTRUCTIONS

The converter DAT 2145 must be powered by a direct voltage included in the 18 V to 30 V range. The power supply must be applied between the terminals R (+Vdc) and P (GND), or alternatively between the terminals Q (+Vdc) and O (GND).

The output connections must be made as shown in the section "Output connections".

The current or voltage output signal is measurable between the terminals N (OUT V/I) and P (GND), or alternatively between the terminals M (OUT V/I) and O (GND).

The input connections must be made as shown in the section "Input connections".

The thermocouple sensor must be connected between the terminals L (+TC) and I (-TC); in case of use of a shielded cable, connect the shield to the terminal I. The configuration of input and output ranges values is made by DIP-switches (refer to the section "Input range table" and "Output range table").

After the converter configuration, it is necessary to calibrate it using the ZERO and SPAN regulations; this operation is illustrated in the section "DAT 2145: Configuration and calibration".

This operation can be made on field refer to a calibrated thermometer or using a simulator of thermocouple; in case of use of simulator of thermocouple with internal CJC, the value of voltage corresponding to the ambient temperature must be subtracted from the input voltage.

To install the device refer to the section "Installation instructions".

TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in nominal conditions)

Input

Sensor type Thermocouple type J, K, R, S and T

Zero programmability Programmable from -50 up to 50 °C or from - 58 up to 122 °F

Span programmability

Thermocouple type K: from 100 up to 1370 °C or from 210 up to 2500 °F

Thermocouple type J: from 100 up to 900 °C or from 210 up to 1650 °F

Thermocouple type R: from 700 up to 1760 °C or from 1200 up to 3200 °F

Thermocouple type S: from 700 up to 1760 °C or from 1290 up to 3200 °F

Thermocouple type T: from 100 up to 450 °C or from 210 up to 840 °F

Input impedance $$\rm >/=10~M\Omega$$ Line resistance influence $$\rm 0,2~\mu V~/~\Omega$$

Output

Signal type Configurable:4 ÷ 20 mA, 0 ÷ 20 mA, 0÷10 V Burnout condition Positive out of scale (> 20 mA or > 10 V)

Maximum output signal 30 mA or 18 Vdc

Response time (from 10 to 90 % of f.s.) 500 ms Warm-up time 3 minutes

Performances

Calibration error $> \text{ of } \pm 0.1 \% \text{ of f.s. or } 0.2 \degree \text{C}$

Linearity error (*) $\pm 0.05 \%$ of f.s.

Cold Junction Compensation ± 0.5 °C

Thermal drift 0.02 % of f.s./°C (for Span > 300 °C / 500 °F)

Power supply voltage (**) 18 ÷ 30 Vdc Current consumption Current output: 40 mA max.

Voltage output: 10 mA max.

Electromagnetic Compatibility (EMC) Immunity: EN 61000-6-2; Emission: EN 61000-6-4

Operating temperature $-20 \div 70$ °C Storage temperature $-40 \div 85$ °C Relative humidity (non cond.) $0 \div 90\%$ Weight approx. 90 g

(*) inclusive of hysteresis and power supply variation.

(**) internally protected against polarity reversion.

DAT 2145: CONFIGURATION & CALIBRATION

- 1) Calculate the difference between the maximum and the minimum value of the input range (Span).
- 2) Refer to the "Input ranges table", find the thermocouple in use and determine in the column " PROG SPAN " where the calculated value is included. Determine in the column " PROG ZERO", the range of value where the zero scale value is included. In the side, is shown the relative DIP-switches configuration.

DIP-switches configuration.

Refer to the "Output ranges table " and determine in the column "Output signal" the position of the output value.

In the correspondent lines is shown as to set the DIP-switches .

- 3) Set the DIP-switches as indicated .
- 4) Connect on input a simulator of thermocouple.
- 5) Set the simulator at the minimum temperature.
- 6) By the ZERO potentiometer calibrate the output at the minimum value .
- 7) Set the simulator at the maximum temperature.
- 8) By the SPAN potentiometer calibrate the output at the maximum value .
- 9) Repeat the operation from the step 5 to the step 8 until the output value will be correct (3 attempts typically required).

Configuration ex. : 0/400 °C Tc "K" out 0÷10 Vdc Span => 400°C;

Input switches configuration (DSI): On, On, On, On. Output switches configuration (DSO): Off, On, Off, On, Off.

INPUT RANGES TABLE

Г	THERMOCOUPLE K	SWITCH		H	THERMOCOUPLE K	sw
	PROG. SPAN	1	2	3	PROG. ZERO	4
Г	100÷150°C (210÷300 °F)				- 50 ÷ - 10°C (-58 ÷ 14 °F)	
ſ	150÷505°C (300÷940 °F)	•	•	•	-10 ÷ 50 °C (14 ÷ 122 °F)	•
Г	505÷1370°C (940÷2500 °F)					

THERMOCOUPLE J	SWITCH			THERMOCOUPLE J	SW
PROG. SPAN	1	2	3	PROG. ZERO	4
100÷115°C (210÷240 °F)		•		- 50 ÷ - 10°C (-58 ÷ 14 °F)	
115÷200°C (240÷390 °F)		•	•	-10 ÷ 50 °C (14 ÷ 122 °F)	
200÷600°C (390÷1110 °F)		•	•	,	
600÷900°C (1110÷1650 °F)					

THERMOCOUPLE R	SWITCH					
PROG. SPAN	1	2	3	4] r	
700÷800°C (1290÷1470 °F)		•			b	
800÷1760°C (1470÷3200 °F)		•	•	•		

The programming of the Zero is not necessary; it can be adjusted from -50 up to 50 °C by the Zero potentiometer.

THERMOCOUPLE S	SWITCH				
PROG. SPAN		2	3	4	
700÷800°C (1290÷1470 °F)		•			1
800÷1760°C (1470÷3200 °F)		•	•		1

The programming of the Zero is not necessary; it can be adjusted from -50 up to 50 °C by the Zero potentiometer.

					_
THERMOCOUPLE T	SWITCH				
PROG. SPAN		2	3	4	1
100÷150°C (210÷300 °F)		•			1
150÷450°C (300÷840 °F)					1

The programming of the Zero is not necessary; it can be adjusted from -50 up to 50 °C by the Zero potentiometer.

OUTPUT RANGES TABLE

OUTPUT SIGNAL		DSO					
	1	2	3	4	5		
0÷20 mA	•	•	•				
4÷20 mA	•		•		•		
0÷10 V		•		•			


= DIP SWITCHES: "ON"

INSTALLATION INSTRUCTIONS


The device DAT 2145 is suitable for DIN rail mounting. It is necessary to install the device in a place without vibrations. Moreover, it is recommended to use shielded cable to connect signals and to avoid routing conductors near power signal cables.

CONNECTIONS DAT 2145


INPUT CONNECTIONS

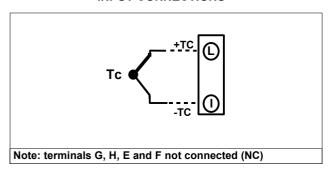


POWER SUPPLY CONNECTIONS

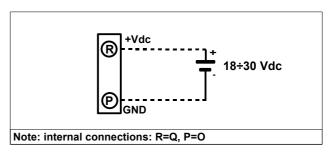

OUTPUT CONNECTIONS

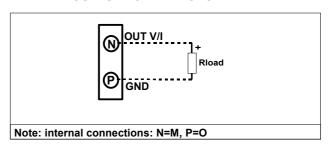

DIMENSIONS (mm) & SETTINGS

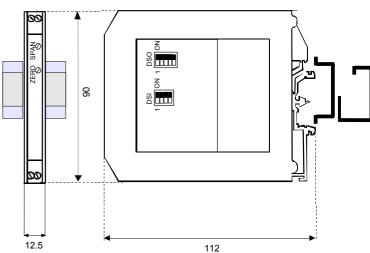

HOW TO ORDER The DAT 2145 is supplied regulated as requested on the order. In case of this data is not specified, the device will be supplied with the standard configuration: ORDER CODE: DAT 2145 - K -0÷1200 °C -4 ÷ 20 mA Tc type Input range Unit of measure Output range