



SILGE ELECTRONICA S.A.

Av. Mitre 950 – B1604AKN - Florida Tel. 4730-1001-Fax: 4760-4950

Email: ventas@silge.com.ar Internet: <http://www.silge.com.ar>

Bulletin No. MLPS1-A

Drawing No. LP0582

Released 7/04

MODEL MLPS1 - MICRO-LINE POWER SUPPLY

- PROVIDES +12 VDC POWER FOR THE MICRO-LINE SERIES
- 12 VDC OUTPUT @ 400 mA
- EASILY ATTACHED TO BACK OF DT8, DT9, CUB4 AND CUB5



DESCRIPTION

The Model MLPS1 is a +12 VDC power supply designed to attach to the rear of the Micro-Line Series. The MLPS1 can be powered from an 85-250 VAC source.

Caution: The maximum output current of the MLPS is 400 mA. Check the specifications of the specific counter(s)/indicators(s) and sensors(s) being used to ensure that total current requirements do not exceed 400 mA.

SAFETY SUMMARY

All safety related regulations, local codes and instructions that appear in the manual or on equipment must be observed to ensure personal safety and to prevent damage to either the instrument or equipment connected to it. If equipment is used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.




CAUTION: Read complete instructions prior to installation and operation of the unit.



CAUTION: Risk of electric shock.

DIMENSIONS In inches (mm)

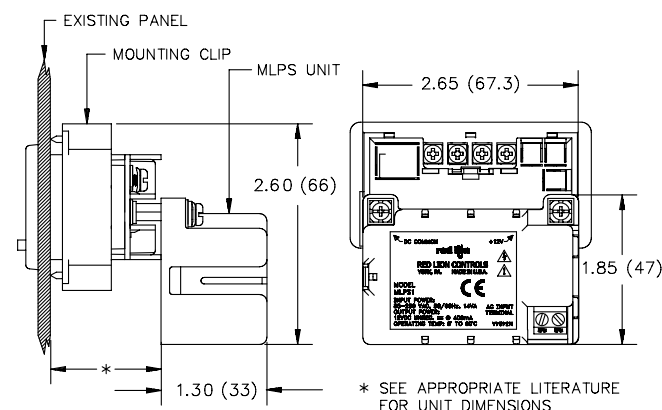

SPECIFICATIONS

- POWER REQUIREMENTS:** 85-250 VAC, 50/60 Hz, 14 VA.
- POWER OUTPUT:** +16 VDC max @ 4 mA
11.5 VDC min @ 400 mA
- ENVIRONMENTAL CONDITIONS:**
 - Operating Temperature:** 0 to 60°C
 - Storage Temperature:** -30 to 75°C
 - Operating and Storage Humidity:** 85% max. (non-condensing) from 0°C to 50°C.
 - Altitude:** Up to 2000 meters
- CERTIFICATIONS AND COMPLIANCES:**
 - ELECTROMAGNETIC COMPATIBILITY**
 - Emissions and Immunity to EN 61326: Electrical Equipment for Measurement, Control and Laboratory use.
 - Immunity to Industrial Locations:**

Test	Standard	Criterion
Electrostatic discharge	EN 61000-4-2	Criterion A 4 kV contact discharge 8 kV air discharge
Electromagnetic RF fields	EN 61000-4-3	Criterion A 10 V/m
Fast transients (burst)	EN 61000-4-4	Criterion A 2 kV power 1 kV signal
Surge	EN 61000-4-5	Criterion B 1 kV L-L, 2 kV L&N-E power 1 kV signal
RF conducted interference	EN 61000-4-6	Criterion A 3 V/rms
Voltage dip/interruptions	EN 61000-4-11	Criterion A 0.5 cycle
 - Emissions:**

Standard	Class
EN 55011	Class B

Notes:

1. Criterion A: Normal operation within specified limits.
2. Criterion B: Temporary loss of performance from which the unit self-recovers.
5. **CONSTRUCTION:** High impact black plastic. Mounting hardware included. Installation Category II, Pollution Degree 2.
6. **CONNECTION:** Two position terminal block which accepts one 14 AWG wire (torque terminal screws to 5 inch-lbs. [-6Nm]).
7. **WEIGHT:** 2 oz (47 g)

ORDERING INFORMATION

MODEL NO.	DESCRIPTION	PART NUMBER
MLPS1	Micro Line/Sensor Power Supply	MLPS1000

INSTALLATION ENVIRONMENT

The unit should be installed in a location that does not exceed the maximum operating temperature and provides good air circulation. Placing the unit near devices that generate excessive heat should be avoided.

Installation Procedure


The MLPS1 is shipped with all the necessary hardware to mount to the rear of an installed Micro-Line unit. Refer to the instructions that correspond to your Micro-Line unit for proper installation.

TROUBLESHOOTING

For further technical assistance, contact technical support at the appropriate company numbers listed.

CUB4, DT8, DT9

The user must remove the common and V+ screw terminals on the rear of the Micro-Line unit (Save these screw terminals for later use). Install the 1/4" hex drive stand-offs into the common and V+ terminals. The MLPS1 is then mounted to the stand-offs using the screw terminals from the Micro-Line unit with the supplied square washers. AC power can then be connected to the terminal block of the MLPS1.

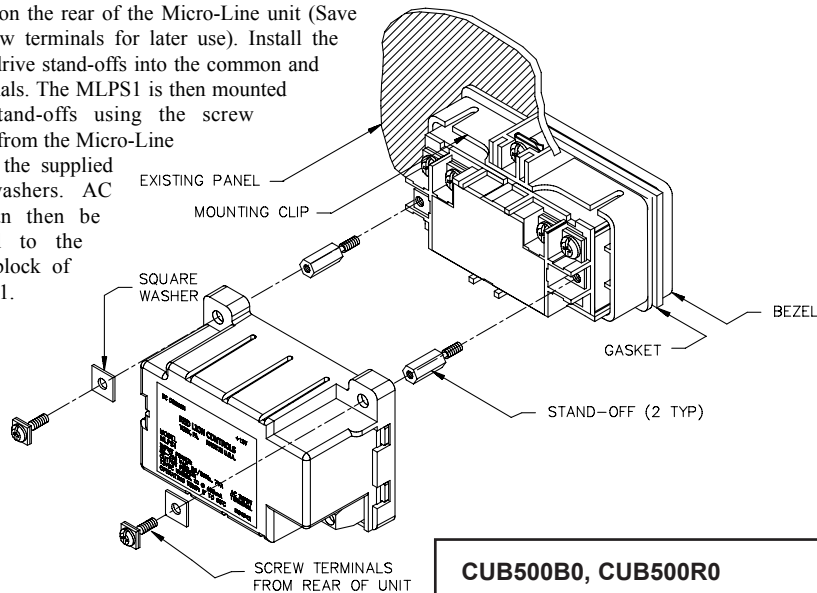

CUB500B0, CUB500R0

The user must remove the common and V+ screw terminals on the rear of the Micro-Line unit. Install the round stand-offs into the common and V+ terminals. The MLPS1 is then mounted to the stand-offs using the supplied screws and square washers. AC power can then be connected to the terminal block of the MLPS1.

